


COVER PER SUBMITTAL

6" Dia

TOP VIEW

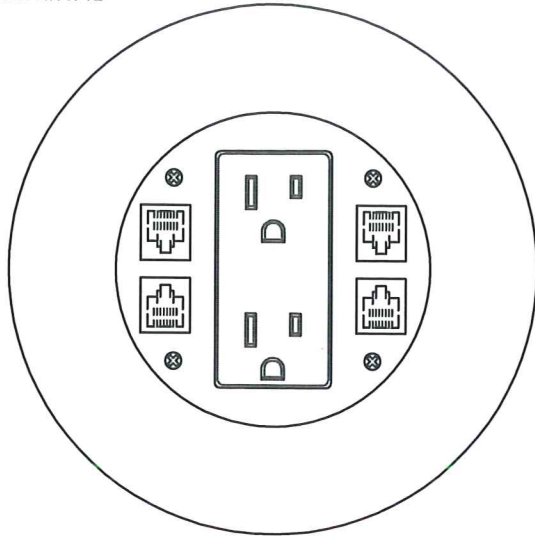


**MOI-SLB-DP1-COMM4**

1 decora duplex receptacle and 4 COMM (suit all manufacturers Keystone style jacks) COMM jacks not supplied or installed by Nocom Inc.

**NOTE:**


Duplex receptacle shall be 5-15RA. 5-20RA available

CROSS SECTION

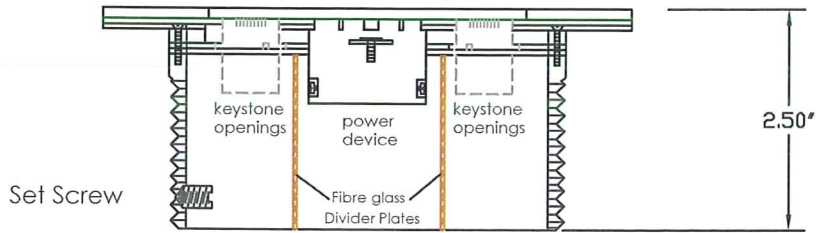

DEVICE MOUNTING BRACKET C/W THREAD HUB AS SHOWN

2.50'

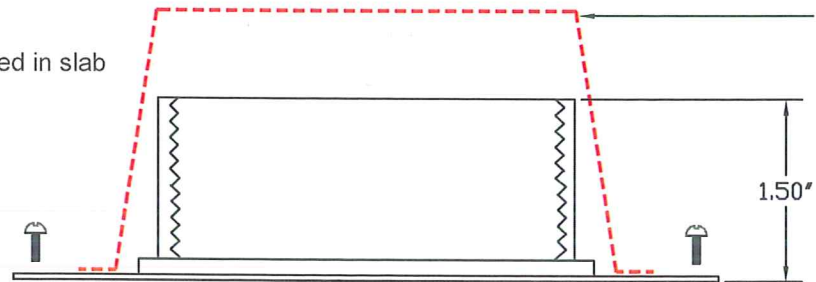


PLASTIC CONE

Poured in slab

1.50'

8"x8" SCREW ON COVER (4 CORNERS) C/W THREAD HUB AS SHOWN MOUNT +1"min. to 2" max. BELOW NEW TILE

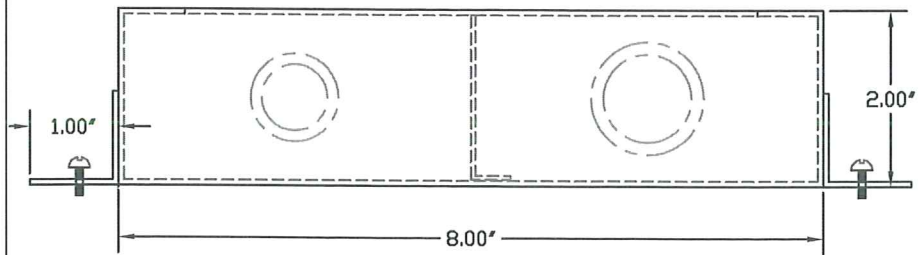



8"x8"x2" STANDARD BOX WITH CENTRE BARRIER C/W 2x[1/2-3/4"] k.o's 2x[3/4"-1"] k.o's

**ORDERING INFO-(SEE ABBREVIATIONS)**

SLAB THICKNESS \_\_\_\_\_  
 RECEPT.TYPE/colour \_\_\_\_\_  
 DATA MANUF./colour \_\_\_\_\_  
 COVER TYPE \_\_\_\_\_

**NOTE:**  
 Duplex receptacle shall be CSA / UL Recognized/Classified or Listed Keystone style openings, blanks or CSA/UL Recognized/ Classified or Listed comm jacks

**PROPRIETARY AND CONFIDENTIAL**  
 THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF NOCOM. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF NOCOM IS PROHIBITED.

		DIMENSIONS ARE IN MM TOLERANCES: ANGLES: ± DEGREE LINEAR: ± MM (UNLESS SPECIFIED)		NAME	DATE (yy-mm-dd)	JOB TITLE:
				DRAWN	TJP	10-03-02
				CHECKED		
				ENG. APPR.		
				MFG APPR.		
				Q.A.		
				COMMENTS:		
MATERIAL		See Variet table				
NEXT ASST	USED ON	FINISH				
APPLICATION		DO NOT SCALE DRAWING				
				 by 		
				888-225-2478		www.nocom.ca
SIZE	DWG. NO.		REV.			
A	MOI-SLB-DP1-COMM4					
SCALE=n.1.s.				WEIGHT:		SHEET 1 OF 1